


- NOTES:
1. FACILITY REQUIREMENTS: 100 PSI MIN AIR PRESSURE (FOR AUTOMATIC WINDOW ONLY)  
120VAC GROUNDED OUTLET (FOR AUTOMATIC WINDOW ONLY)
  2. ALL CLEAN ROOM SIDE MATERIALS USED SHALL BE CLASS 100 CLEAN ROOM COMPATIBLE.

3. WHEN FRAMING OR MODIFYING THE WALL, CONTRACTOR MUST PROVIDE FOR PASSING PNEUMATIC TUBING & ELECTRIC WIRE THRU THE GROMMETTED HOLES SUCH THAT THE TUBING & WIRE IS ROUTED BEHIND THE DRYWALL.

REV	DESCRIPTION	CHG. BY	DATE
1	INITIAL RELEASE - PENDING	G ROTH	02-11-07

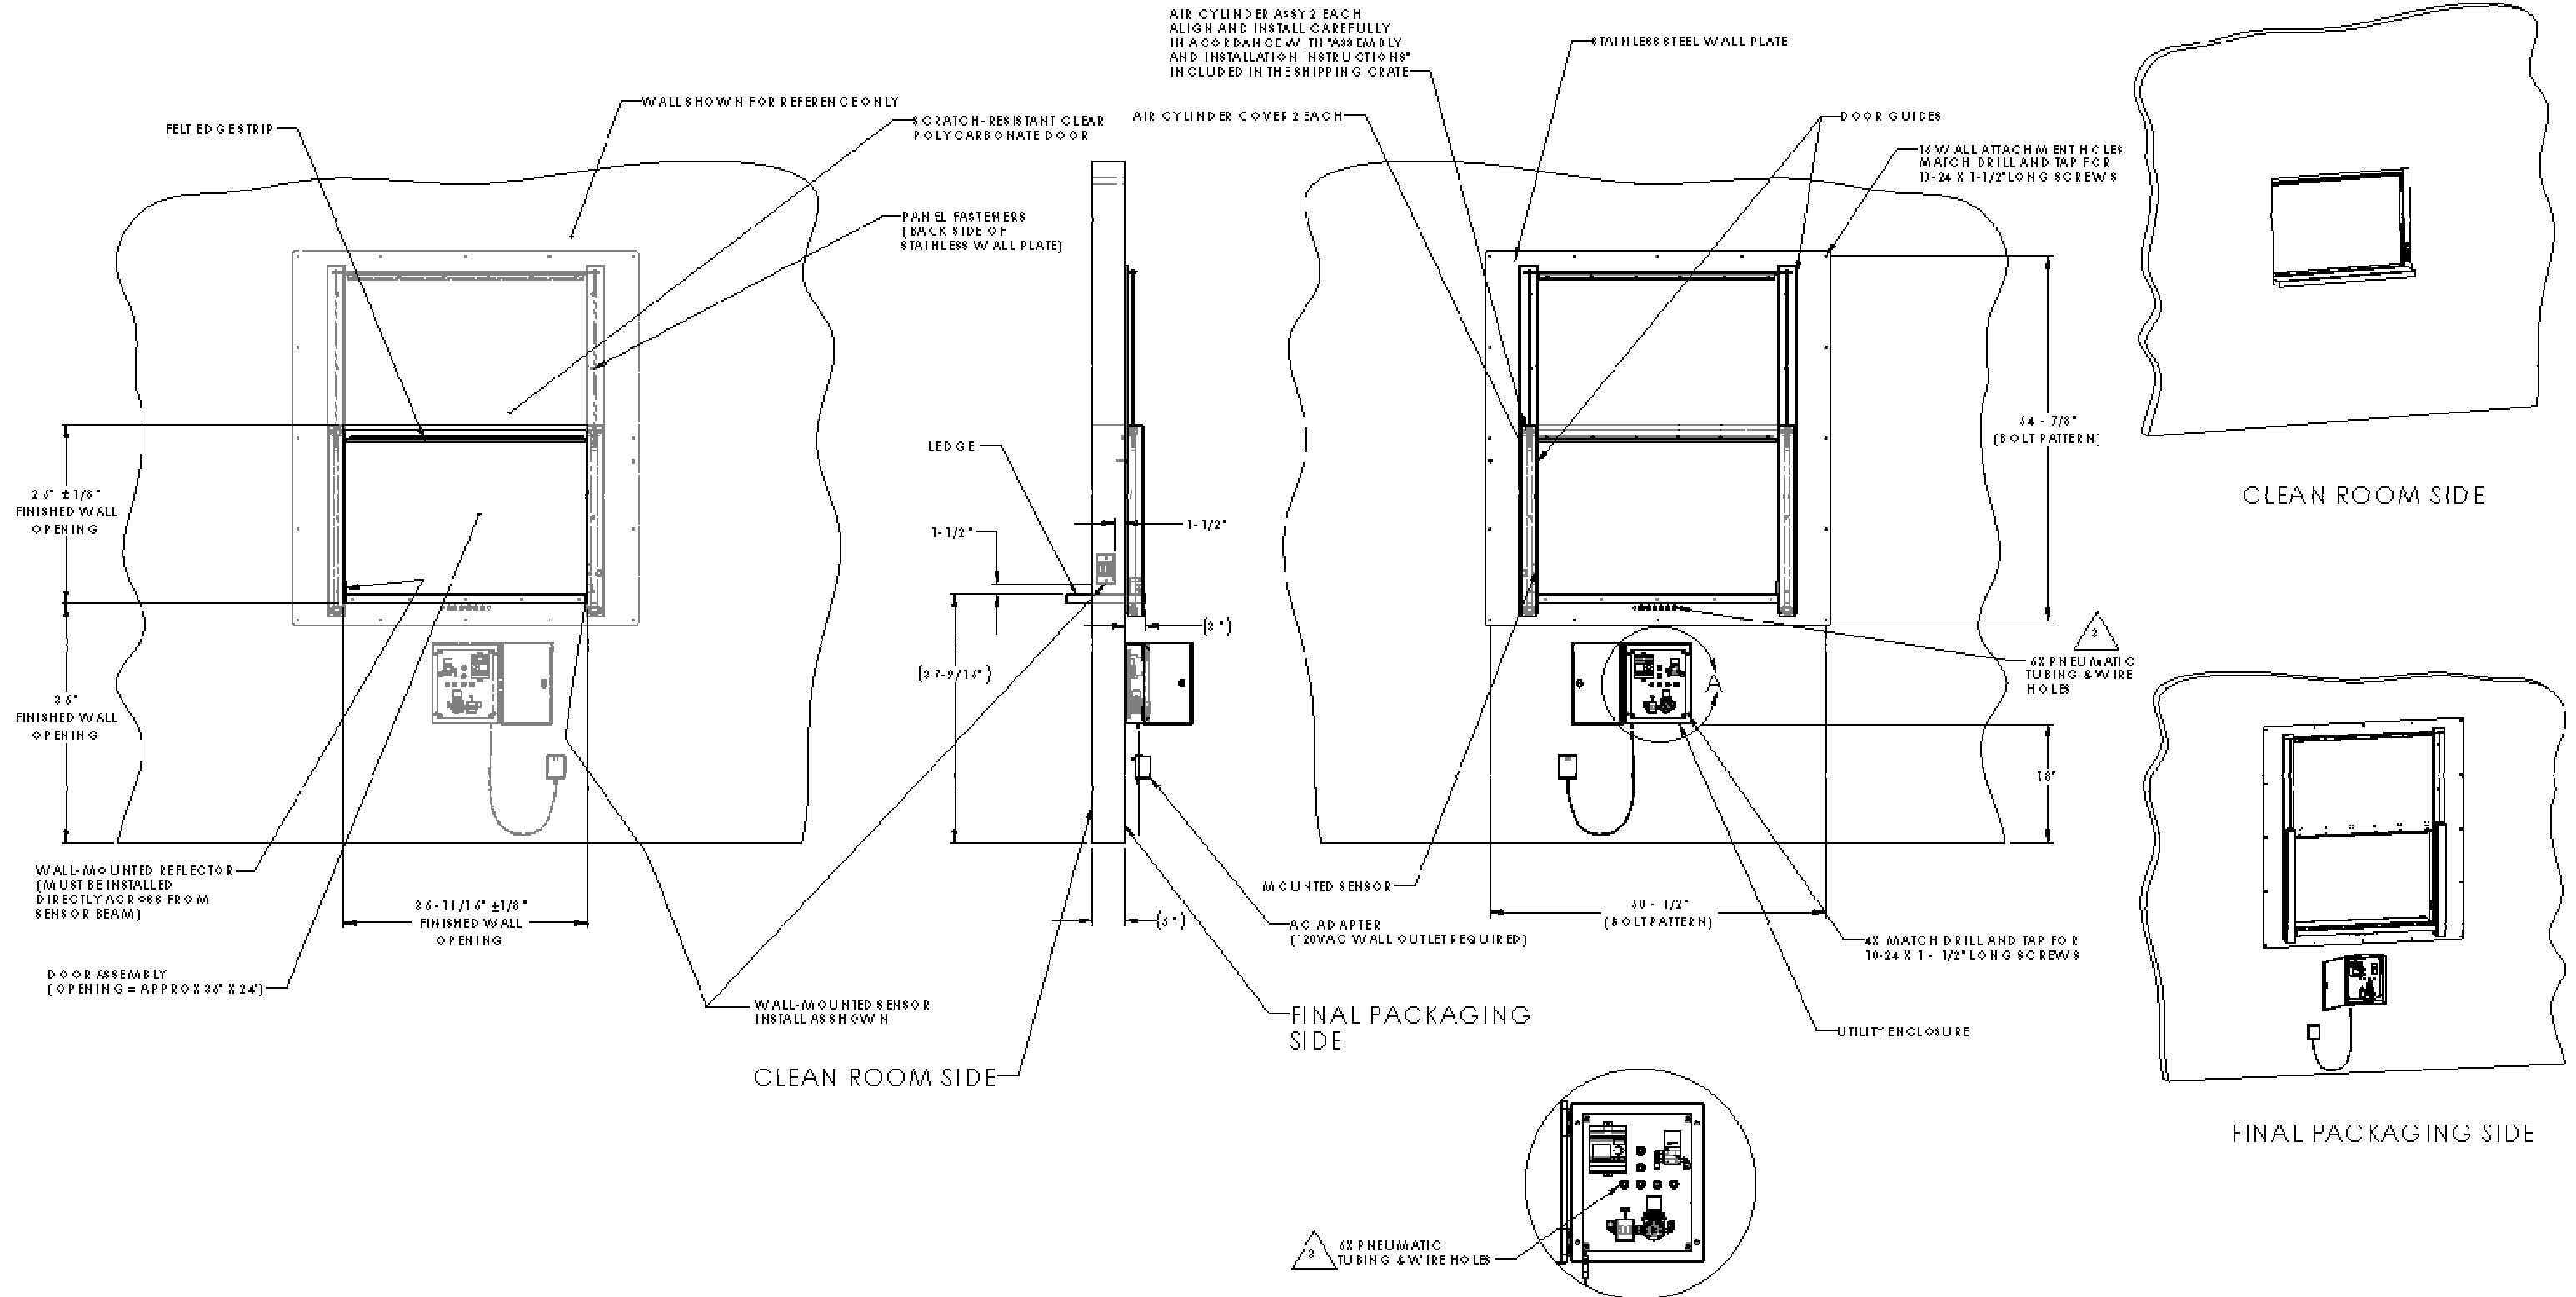

DETAIL A  
SCALE 1:6

REVISIONS

NO.	DESCRIPTION

NO.	DESCRIPTION	DATE	BY	CHKD.

AMT  
INSTALLATION DETAIL,  
PASS-THRU WINDOW  
AUTOMATIC 36" X 24"  
TO HDA

REV: 0003-001  
SCALE: 1/2" = 1'-0"  
SHEET 1 OF 1